

Scale= 1: 1500


Luminaire Location Summary						
LumNo	Label	X	Y	Z	Orient	Tilt
1	BRP711 LED40NW 36W PSDD I DWP3	6.56	-0.64	6	88.817	10
3	BRP711 LED40NW 36W PSDD I DWP3	36	-2	6	88.817	10
4	BRP711 LED40NW 36W PSDD I DWP3	66	-3	6	88.817	10
5	BRP711 LED40NW 36W PSDD I DWP3	95	0	6	100.864	10
6	BRP711 LED40NW 36W PSDD I DWP3	122.339	11.572	6	117.898	10
7	BRP711 LED40NW 36W PSDD I DWP3	148.915	26.068	6	115.453	10
8	BRP711 LED40NW 36W PSDD I DWP3	175.023	38.634	6	111.469	10
9	BRP711 LED40NW 36W PSDD I DWP3	199.763	42.866	6	91.946	10
10	BRP711 LED40NW 36W PSDD I DWP3	229.647	43.777	6	91.946	10
11	BRP711 LED40NW 36W PSDD I DWP3	254.192	39.219	6	63.894	10
12	BRP711 LED40NW 36W PSDD I DWP3	278.802	23.724	6	51.503	10
13	BRP711 LED40NW 36W PSDD I DWP3	302.566	5.299	6	53.892	10
14	BRP711 LED40NW 36W PSDD I DWP3	326.915	-11.303	6	55.221	10
15	BRP711 LED40NW 36W PSDD I DWP3	353.282	-25.301	6	60.354	10
16	BRP711 LED40NW 36W PSDD I DWP3	348.838	-12.003	6	96.561	10
17	BRP711 LED40NW 36W PSDD I DWP3	371.561	-10.605	6	85.904	10
18	BRP711 LED40NW 36W PSDD I DWP3	400.079	-15.862	6	77.459	10
19	BRP711 LED40NW 36W PSDD I DWP3	428.059	-21.07	6	83.875	10
20	BRP711 LED40NW 36W PSDD I DWP3	458.804	-22.047	6	91.441	10
21	BRP711 LED40NW 36W PSDD I DWP3	486.23	-24.895	6	78.541	10
22	BRP711 LED40NW 36W PSDD I DWP3	514.633	-32.3	6	251.584	10

Luminaire Schedule						
Symbol	Qty	Label	Description	LLF	Lum. Watts	Arm Lum. Lumens
—■	21	BRP711 LED40NW 36W PSDD I DWP3	Apex Road Grace 36W DWP3 optic 25-34mm spigot	1.000	36	1.5 4003


Calculation Summary						
Label	CalcType	Meter Type	Units	Max	PtSpcLr	PtSpcTb
ObtrusiveLight_1	Obtrusive Light - III	Vert-PerpCW	Lux	0.6	2	1
ObtrusiveLight_2	Obtrusive Light - III	Vert-PerpCW	Lux	0.0	2	1
ObtrusiveLight_2	Obtrusive Light - III	Vert-PerpCW	Lux	0.1	2	1

The values of light technical parameters shown in this lighting design calculation are nominal. They are based on parameters provided by the client and the specific details as reported in this document. Results in practice may be different due to variations such as luminaire positioning/aiming, surface reflectance, supply voltage, local luminaire ambient temperature, obstacles/furniture, etc. They are also subject to normally accepted photometric tolerances, and calculation/program uncertainties. Apex Lighting shall be under no liability to the Customer for failure to attain such performance figures.

A	13/02/2018	Original Issue	AN	
Rev:	Date:	Comment:	By:	Chkd:



Project:	Manly Lagoon Pathway	Scale:	As Shown	A3
Title:		Page 1 of 2		
Client:		Document No:	18019-01	Rev:
				A

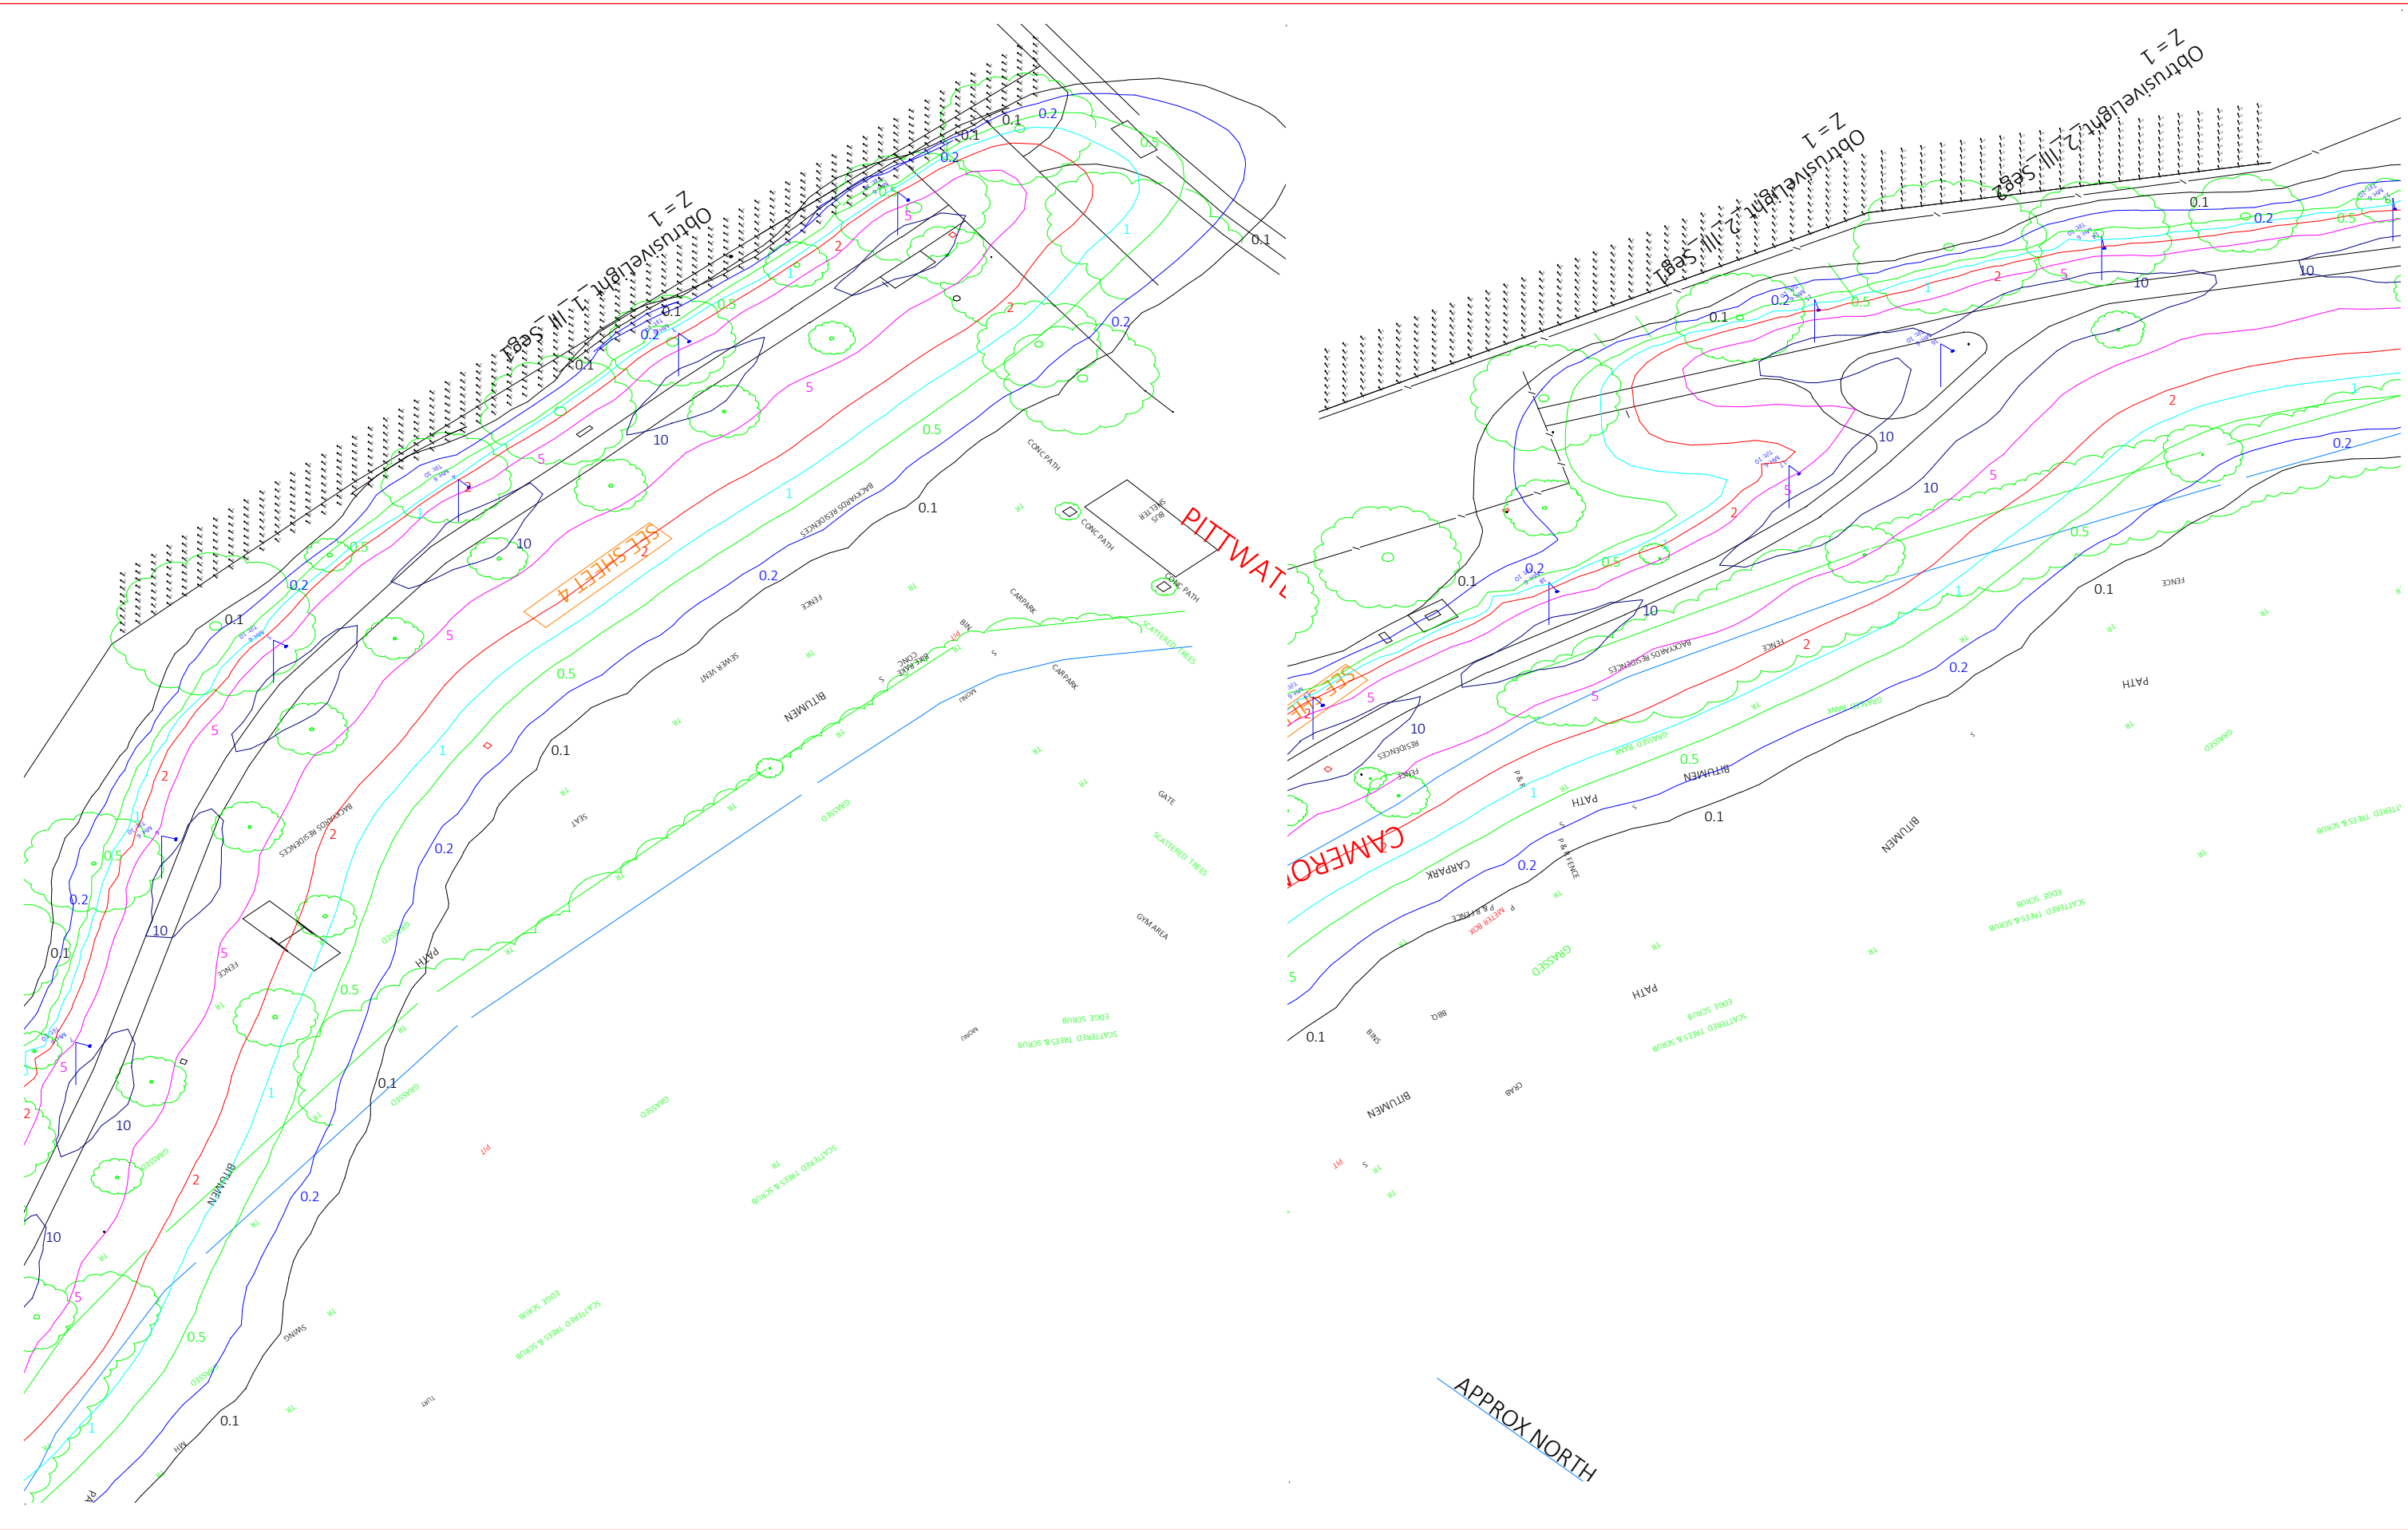

The values of light technical parameters shown in this lighting design calculation are nominal. They are based on parameters provided by the client and the specific details as reported in this document. Results in practice may be different due to variations such as luminaire positioning/aiming, surface reflectance, supply voltage, local luminaire ambient temperature, obstacles/furniture, etc. They are also subject to normally accepted photometric tolerances, and calculation/program uncertainties. Apex Lighting shall be under no liability to the Customer for failure to attain such performance figures.

A	13/02/2018	Original Issue		AN	
Rev:	Date:	Comment:		By:	Chkd:



Project:	Manly Lagoon Pathway	Scale:	As Shown	A3
Title:			Page 2 of 2	
Client:		Document No:	18019-01	Rev:
				A